


ELEVATION

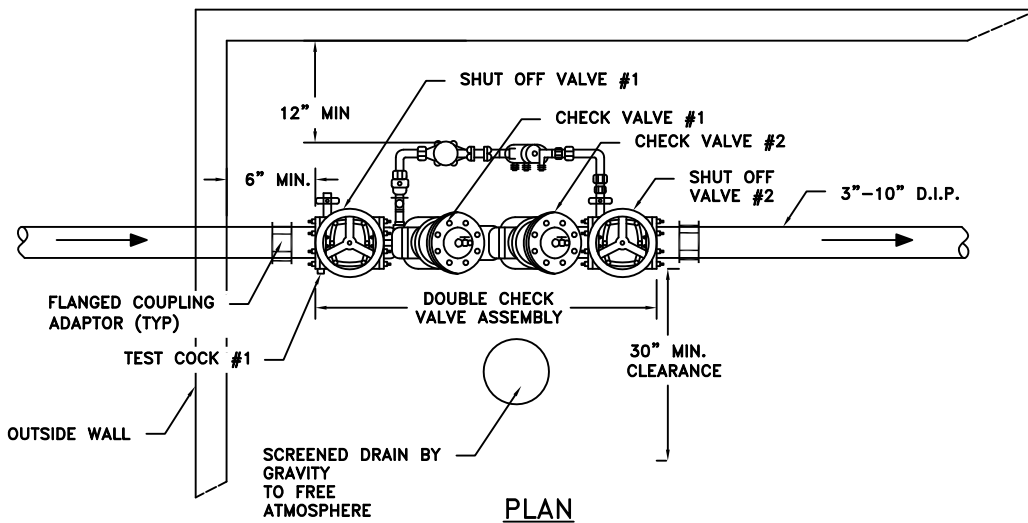

PLAN

## >2" DOUBLE CHECK VALVE BACKFLOW PREVENTER-INTERIOR

**NOTES:**

1. ALL PIPE 3" - 10" SHALL BE D.I.P. FROM THE TAP AT THE MAIN TO 5' PAST SHUT OFF VALVE #2.
2. RESTRAINED JOINTS SHALL BE WITH MEGA LUG RESTRAINTS OR APPROVED EQUAL.
3. DRAIN PIPE SHALL BE SIZED ACCORDING TO THE MANUFACTURERS FLOW CURVE TO DETERMINE THE MAXIMUM DISCHARGE RATE.

REVISIONS		AMERICAN WATER STANDARD CIVIL BACKFLOW PREVENTER-INTERIOR >2" DOUBLE CHECK VALVE
12/13 - MSG EDITS		
01/16 - MSG EDITS		
		AMERICAN WATER MILITARY SERVICES GROUP CAMDEN, NJ 08102
		AMERICAN WATER M.S.G. 1 WATER STREET CAMDEN, NJ 08102
	DRAWN BY JRQ PROJECT ENG'R PDK APPROVED	DATE 12-06-11 PROJECT IP
		USE DIMENSIONS ONLY SCALE N.T.S.
	USE APPROVED DRAWINGS ONLY FOR CONSTRUCTION PURPOSES	MSG-W-20

FINAL

MSG-W-20