


**NOTES:**

1. TEFLON TAPE SHALL BE USED FOR JOIN SEALING ON ALL THREADED PIPE OR FITTINGS. TEFLON PASTE SHALL NOT BE USED.
2. IN CORROSIVE SOIL THE BURIED PIPE SHOULD BE PREPPED FOR ADDITIONAL RESISTANCE TO CORROSION PER THE MANUFACTURERS RECOMMENDATION.
3. STATION SHALL BE ENCLOSED IN A LOCKABLE NON-REMOVABLE UV RESISTANT ALUMINUM BOX WITH HINGED OPENINGS. WHEN OPEN THE STATION SHALL REQUIRE NO KEY FOR OPERATION.
4. ALL WORKING PARTS SHALL BE OF STAINLESS STEEL AND SERVICEABLE FROM ABOVE GROUND.
5. PROVIDE BOLLARDS AROUND ENCLOSURES IN HIGH TRAFFIC AREAS WHEN DIRECTED BY AW PROJECT MANAGER.

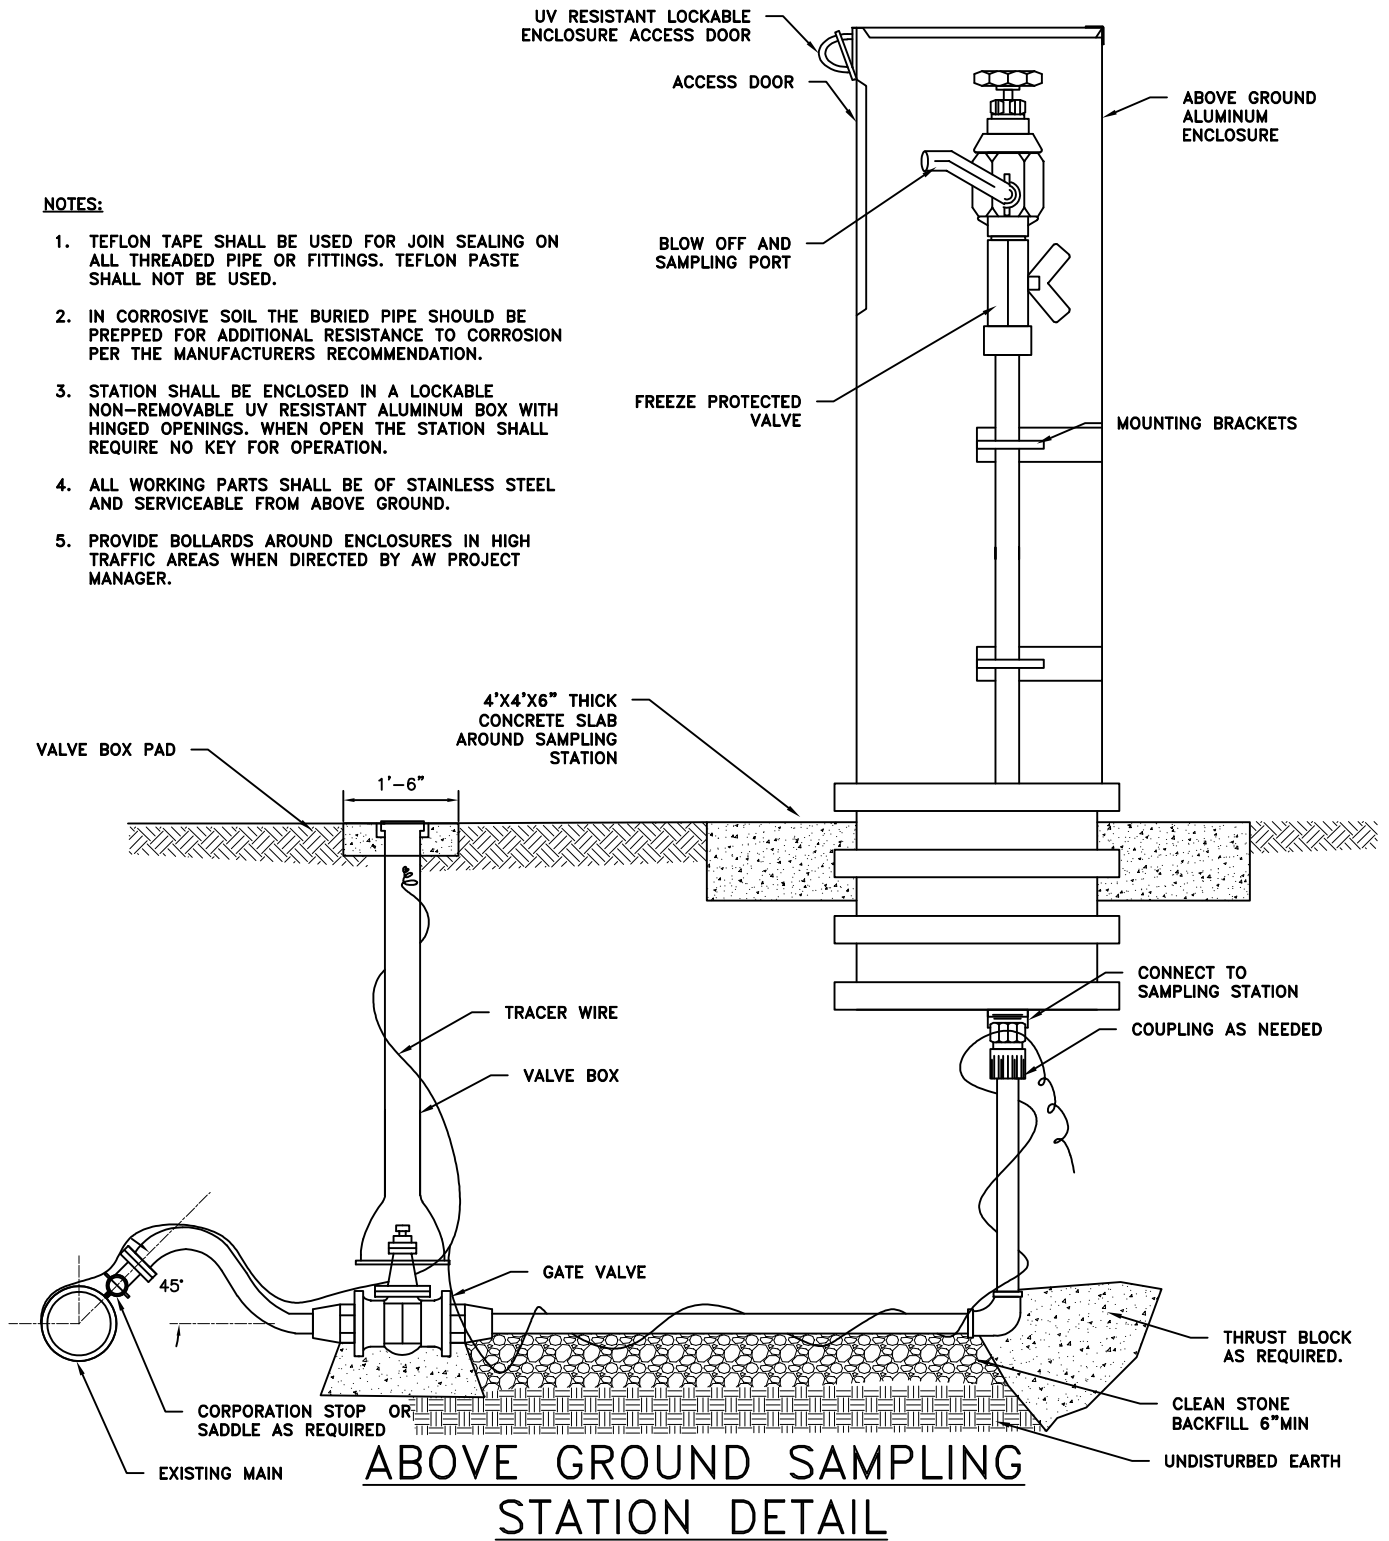

**ABOVE GROUND SAMPLING  
STATION DETAIL**

REVISIONS

AMERICAN WATER MILITARY SERVICES GROUP  
CIVIL  
ABOVE GROUND SAMPLING  
STATION DETAIL

AMERICAN WATER MILITARY SERVICES GROUP  
CAMDEN, NJ 08102

AMERICAN WATER M.S.G.  
1 WATER STREET  
CAMDEN, NJ 08102

**AMERICAN WATER.**

DRAWN BY PDK  
PROJECT ENG'R PDK  
APPROVED

DATE 11-07-2022  
PROJECT N/A

USE DIMENSIONS ONLY  
SCALE N.T.S.

USE APPROVED DRAWINGS ONLY  
FOR CONSTRUCTION PURPOSES

**MSG-W-29**

FINAL

MSG-W-29