



VAULT & ENCLOSURE LOCATION— MAIN IN STREET

NOTES:

1. ALL METERS (3" & LARGER) SHALL BE INSTALLED IN A CONCRETE VAULT.
2. ALL BACKFLOW PREVENTION DEVICES SHALL BE INSTALLED IN AN ABOVEGROUND ENCLOSURE, IMMEDIATELY ADJACENT (I.E. AS CLOSE AS PRACTICABLE) TO THE DISCHARGE SIDE OF THE METER.
3. NOT WITHSTANDING THE ABOVE, IF A METER VAULT AND HEATED BP ENCLOSURE ARE INSTALLED, BOTH STRUCTURES SHALL BE INSTALLED WITHIN 100 FEET OF THE NJAW CONTROL VALVE (MAXIMUM).
4. NJAW MAY WAIVE HEATED BP ENCLOSURE AND ALLOW BACKFLOW PREVENTER INSTALLATION IN BUILDING IF THE 100 FOOT REQUIREMENT IS MAINTAINED.
5. THE INSTALLATION MUST ALSO MEET ALL APPLICABLE CODE & REGULATORY REQUIREMENTS INCLUDING THE NATIONAL STANDARD PLUMBING CODE AND NEW JERSEY STATUTES AND REGULATIONS.

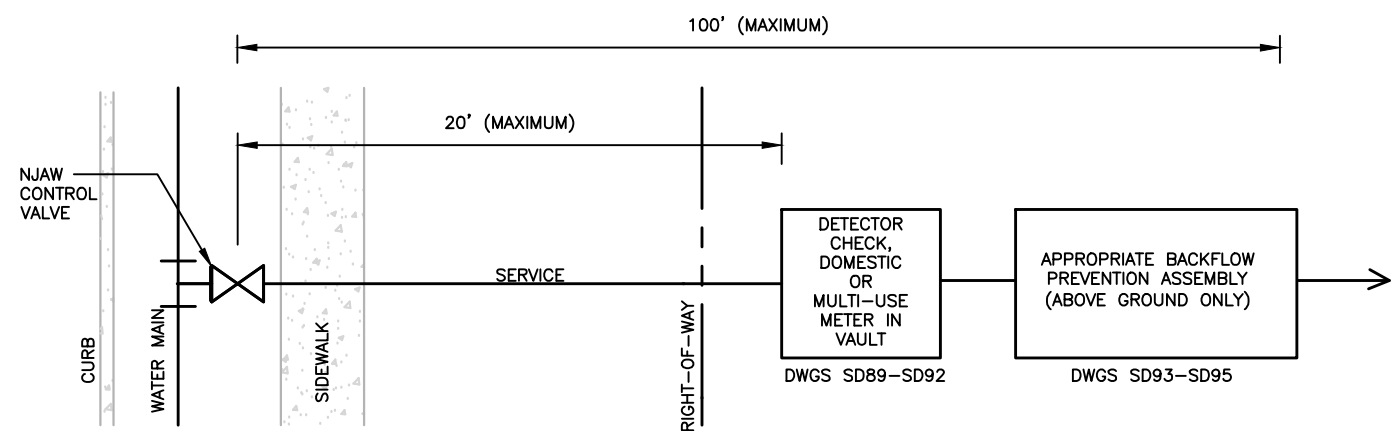

VAULT & ENCLOSURE LOCATION— MAIN BEHIND CURB

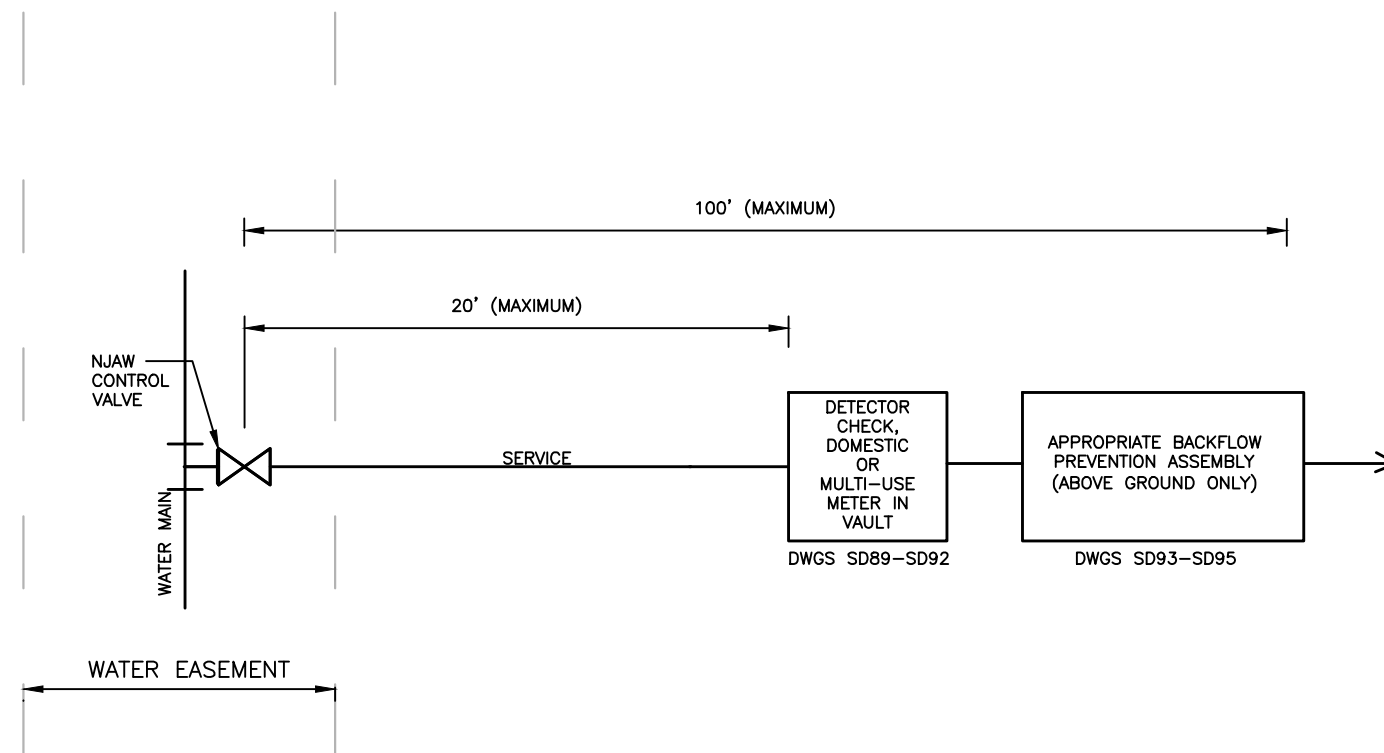


VAULT & ENCLOSURE LOCATION— MAIN IN EASEMENT



REVISIONS		REVISIONS	
△		△	
△		△	
△		△	
△		△	
△		△	

NJ LICENSED PROFESSIONAL ENGINEER

AMERICAN WATER ENGINEERING
3908 CHURCH RD.
MT. LAUREL, NJ 08054



AMERICAN WATER

DRAWN BY D. JOBE
PROJECT ENG'R E. SCHWARTZ

DATE 08-24-18

PROJECT

**STANDARD DETAIL
DOMESTIC, FIRE & MULTI-USE SERVICE
LOCATION SCHEMATIC**

NEW JERSEY AMERICAN WATER

USE APPROVED DRAWINGS ONLY
FOR CONSTRUCTION PURPOSES

USE DIMENSIONS ONLY
SCALE NOT TO SCALE

0201-0601-SD88

02010601SD88